

Flush Valves

Flush valve with 1-3/8" dia. push button activation-for 1-1/2" top inlet closet fixture

Model No: 83T343-1

COMPLIES WITH:

- IAPMO listed to CSA B125.3/ ASSE 1037.
- (Contact Delta Representative for State and/or Local Approvals)



SPECIFICATION:

- Quiet action Teck® concealed diaphragm flush valve
- Adjustable 110mm (4.31") to 132mm (5.19") inlet/Valve outlet centers
- Vacuum breaker
- . Renewable seat
- Chloramine resistant diaphragm attached to guide with forged metal retainer
- Pressure loss check angle stop with wheel handle
- Vandal resistant handle control can easily be located and installed anywhere within 6m (20') of flush valve
- Standard flush valve will install on all walls 0 mm to 344 mm (13.5") thick
- For 1-1/2" top inlet closet fixture
- Metal "non hold open" 1 3/8" (35mm) dia. push button actuator
- 1" FIP/copper sweat inlet adaptor
- Polished chrome plated finish on exposed trim
- Wall and spud flanges, concealed spud nut, elbow and tubing
- Trap Seal Primer/Disinfectant Tee in outlet tube
- External water conserving flush adjustment: Factory set to 6 Litre(1.6 Gal.) -Field Adjustable from 4.8L to 25L (1.27 to 6.6 Gal.)


OPERATION:

Adjustable flush volume using adjustment screw on flush valve

(Dimensional drawing on following page)

Delta reserves the right (1) to make changes to specifications and materials, and (2) to change or discontinue models, both without notice or obligation. Dimensions are for reference. Measurement may vary plus or minus 6mm(0.25"). Mounting locations are suggested only. Check with local codes for requirements in your area. This spec was produced October 16, 2014.



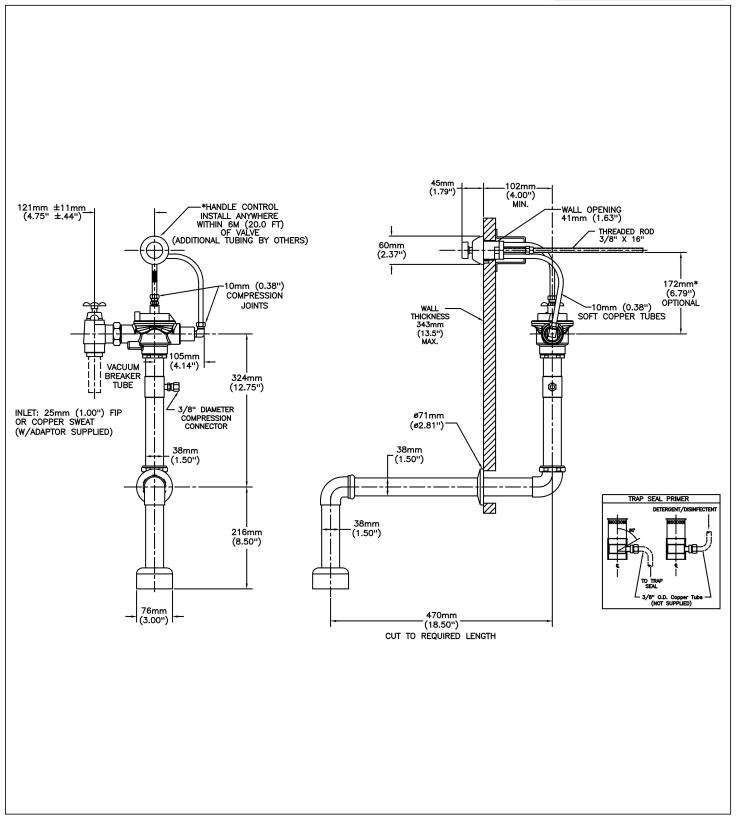

Delta reserves the right (1) to make changes to specifications and materials, and (2) to change or discontinue models, both without notice or obligation. Dimensions are for reference. Measurement may vary plus or minus 6mm(0.25"). Mounting locations are suggested only. Check with local codes for requirements in your area. This spec was produced October 16, 2014.